


Mass Spectrum

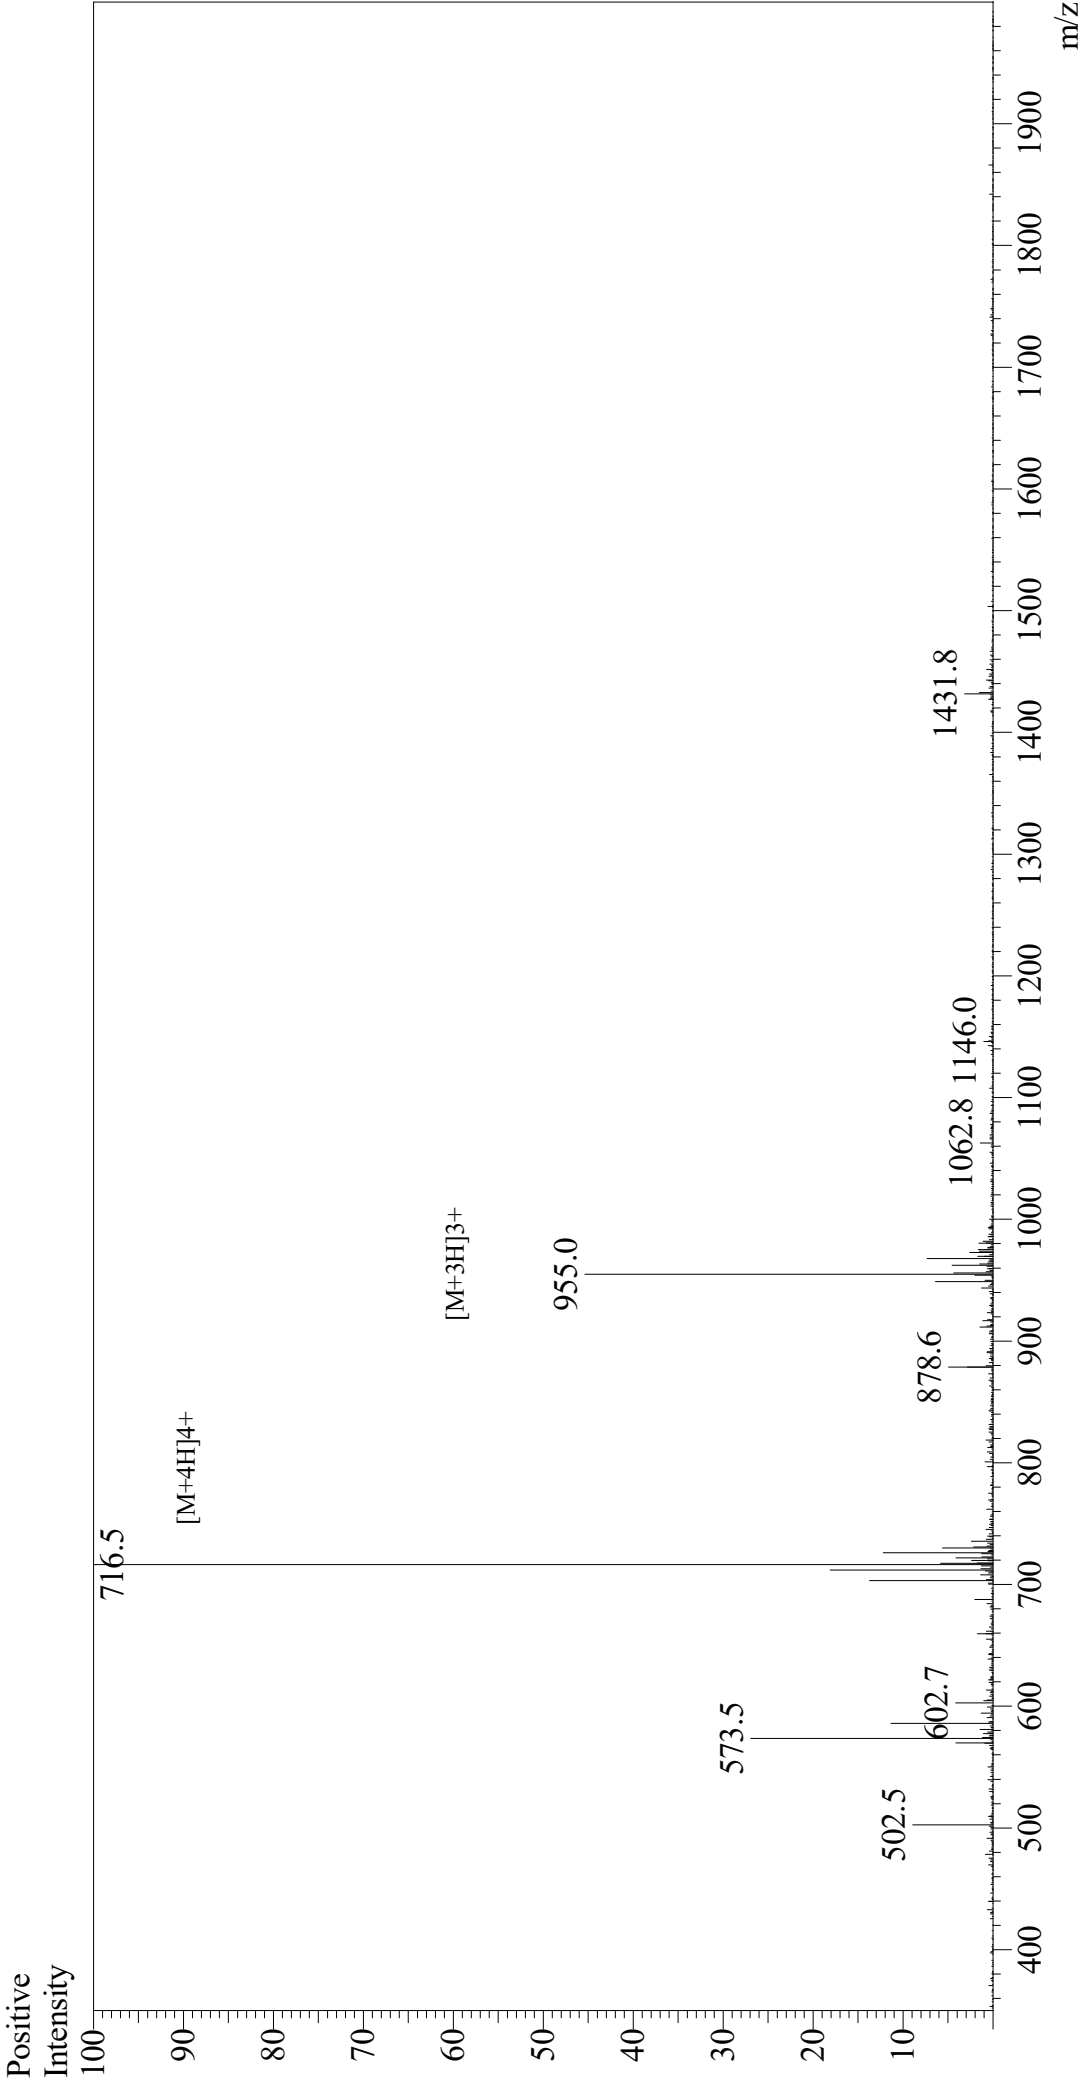

Sample Information
Month-Day Processed : 06/19/21
Time Processed : 19:51:47
Injection Volume : 0.2
Sample Name : MDYKDHDGDYKDHIDYKDDDDK peptide
Cat No. : RP21087
Lot No. : E8965021F
Theoretical MW : 2861.87
Observed MW : 2862.0

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : GK11010007
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H₂O/50% MeOH